

TWO MULTIFUNCTION RELAYS KIT FOR TRIO PACK CODE 3.031943

GENERAL WARNINGS.

All the products are protected with suitable transport packaging.

The material must be stored in dry environments and protected against weath-ering.

This instruction manual provides technical information for installing the kit. As for the other issues related to kit installation (e.g. safety in the work site, environment protection, injury prevention), it is necessary to comply with the provisions specified in the regulations in force and principles of good technique. Improper installation or assembly of the appliance and/or components, acces-sories, kit and devices can cause unexpected problems to people, animals and objects. Read the instructions provided with the product carefully to ensure a proper installation of same.


Installation and maintenance must be performed in compliance with the regu-lations in force, according to the manufacturer's instructions and by authorised professionally qualified staff, intending staff with specific technical skills in the plant sector, as envisioned by the Law.

DESCRIPTION.


The kit with two multifunction relays allows to enable the control of room dehumidifiers in neutral air or in cooled air, or of a summer/winter diverter valve. Before performing any intervention, disconnect the power supply to the installed indoor unit by acting on the switch placed upstream from the appliance.

TWO RELAYS KIT INSTALLATION (FIG. 1).

- Open the electrical panel (1) by removing the screws (2).
- Remove the locking device (3).
- Insert the two relays (4) supplied on the support bracket (5).
- Refit the locking device (3).

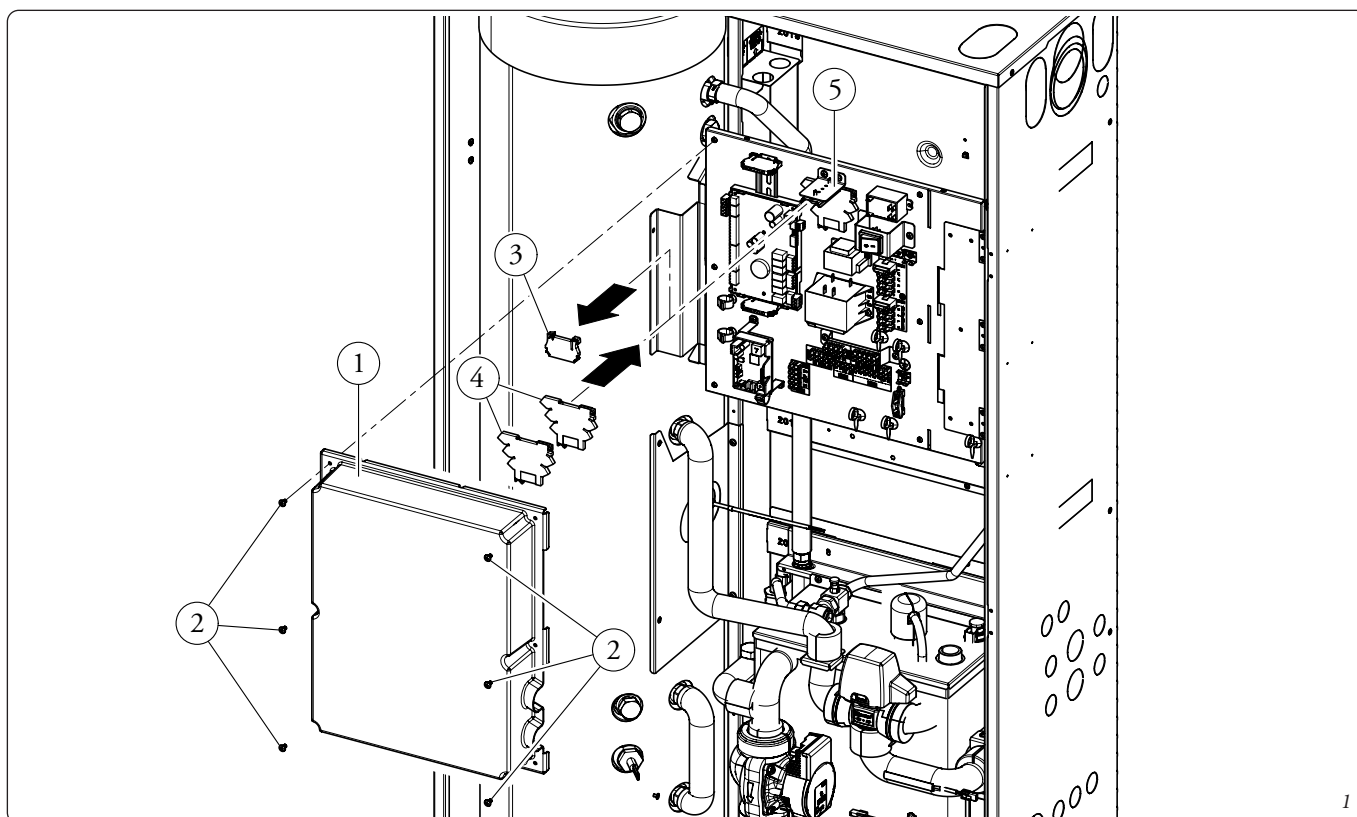


- Connect the 3-poles connector (6) at the output of the two relays with the connector (7) located near the two relays as indicated in Fig. 2.
- Secure the 4-poles terminal block (8) on the panel remembering to interpose the plate (9) and to use the screws (10) supplied as indicated in Fig. 2.
- At the end, close the electrical panel with the screws previously removed.

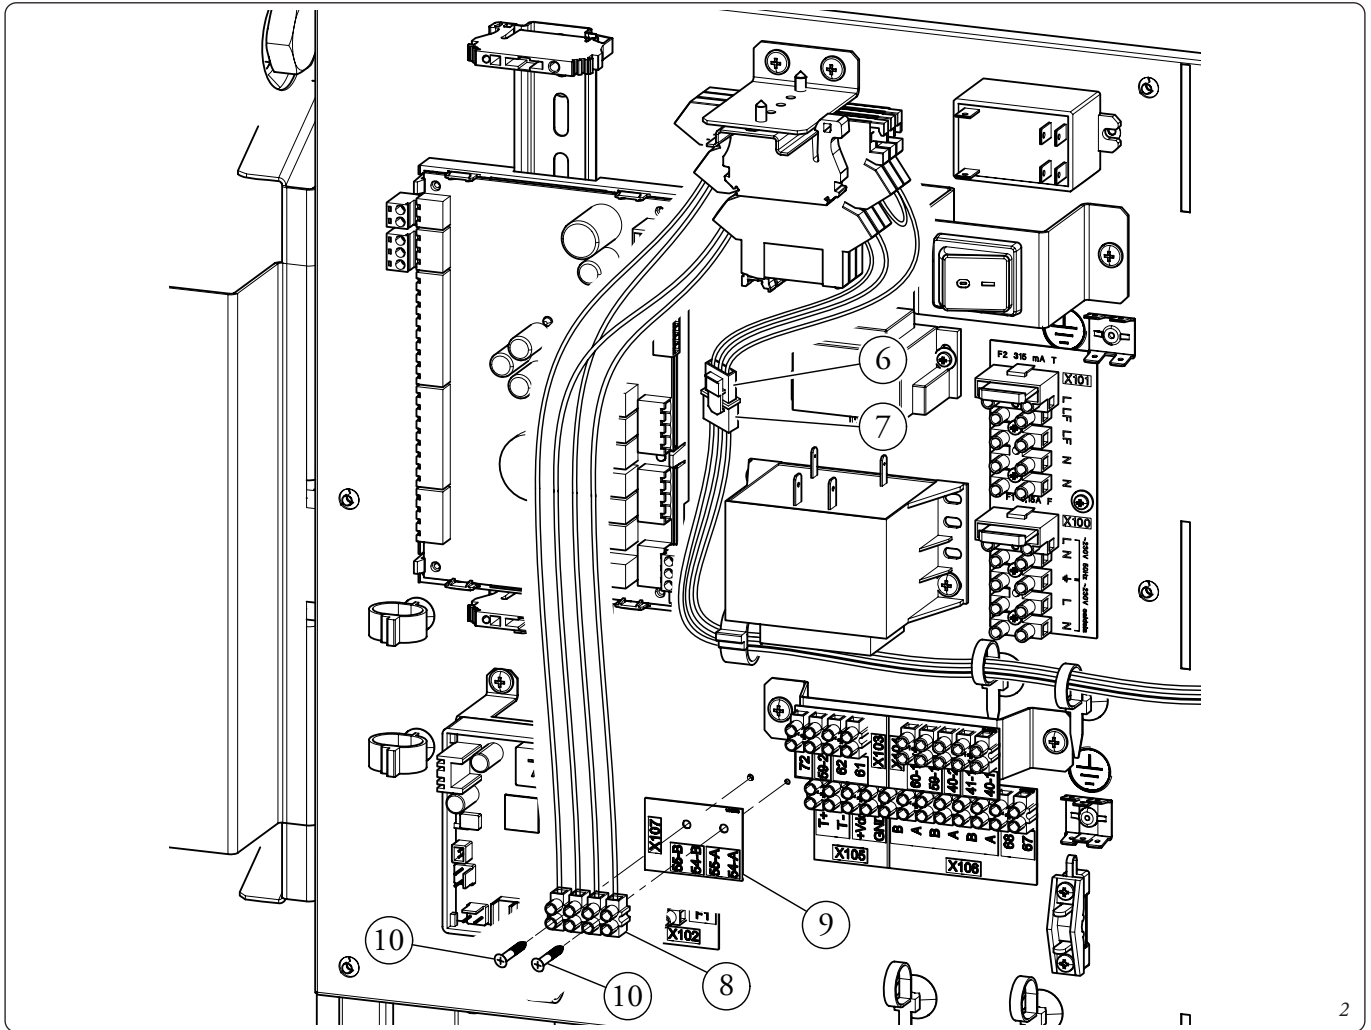

2

TWO RELAYS CONNECTION DIAGRAM

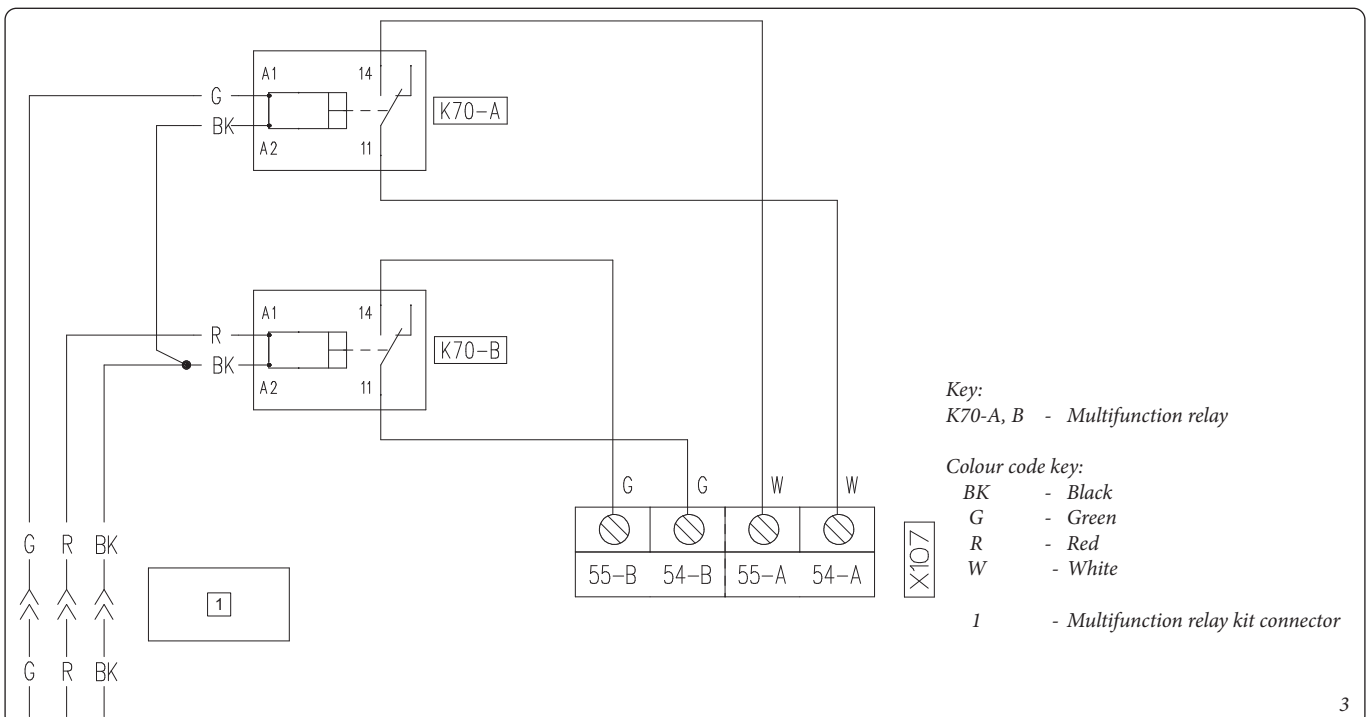

3